


11905/11920 Sub-D DB-25 Male

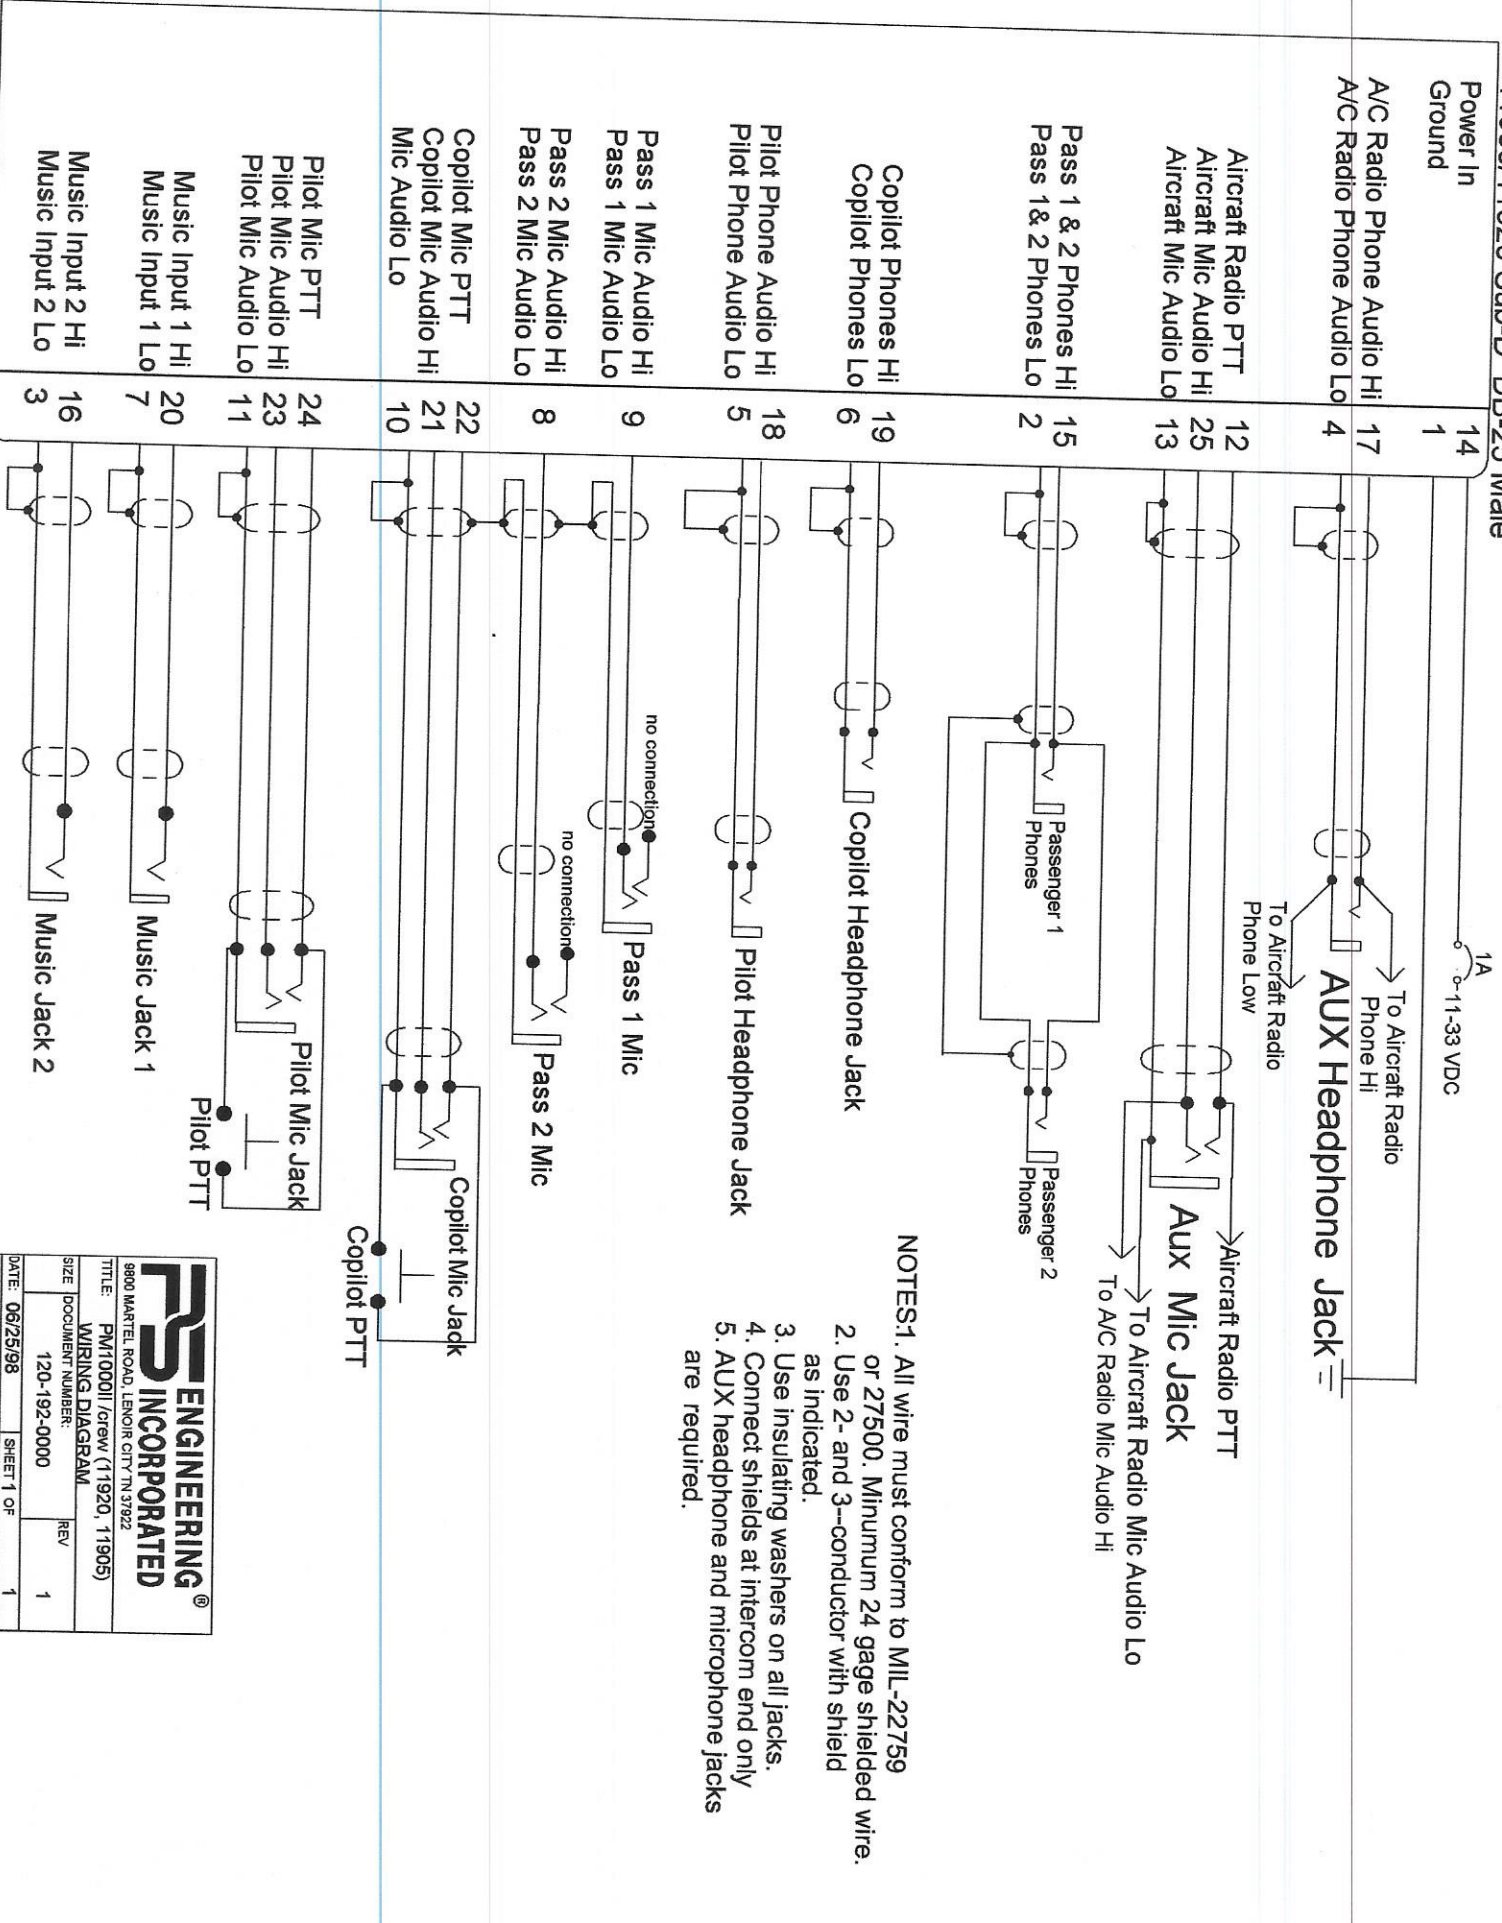

NOTES: 1. All wire must conform to MIL-22759 or 27500. Minimum 24 gage shielded wire.  
 2. Use 2- and 3--conductor with shield as indicated.  
 3. Use Insulating washers on all jacks.  
 4. Connect shields at intercom end only  
 5. AUX headphone and microphone jacks are required.

9800 MARTEL ROAD, LENOIR CITY TN 37922	
TITLE:	PM10001 /crew (11920, 11905)
SIZE	WIRING DIAGRAM
DOCUMENT NUMBER:	120-192-0000
REV	1
DATE:	06/25/98
SHEET	1 OF 1