


11800 Sub-D DB-15 Male

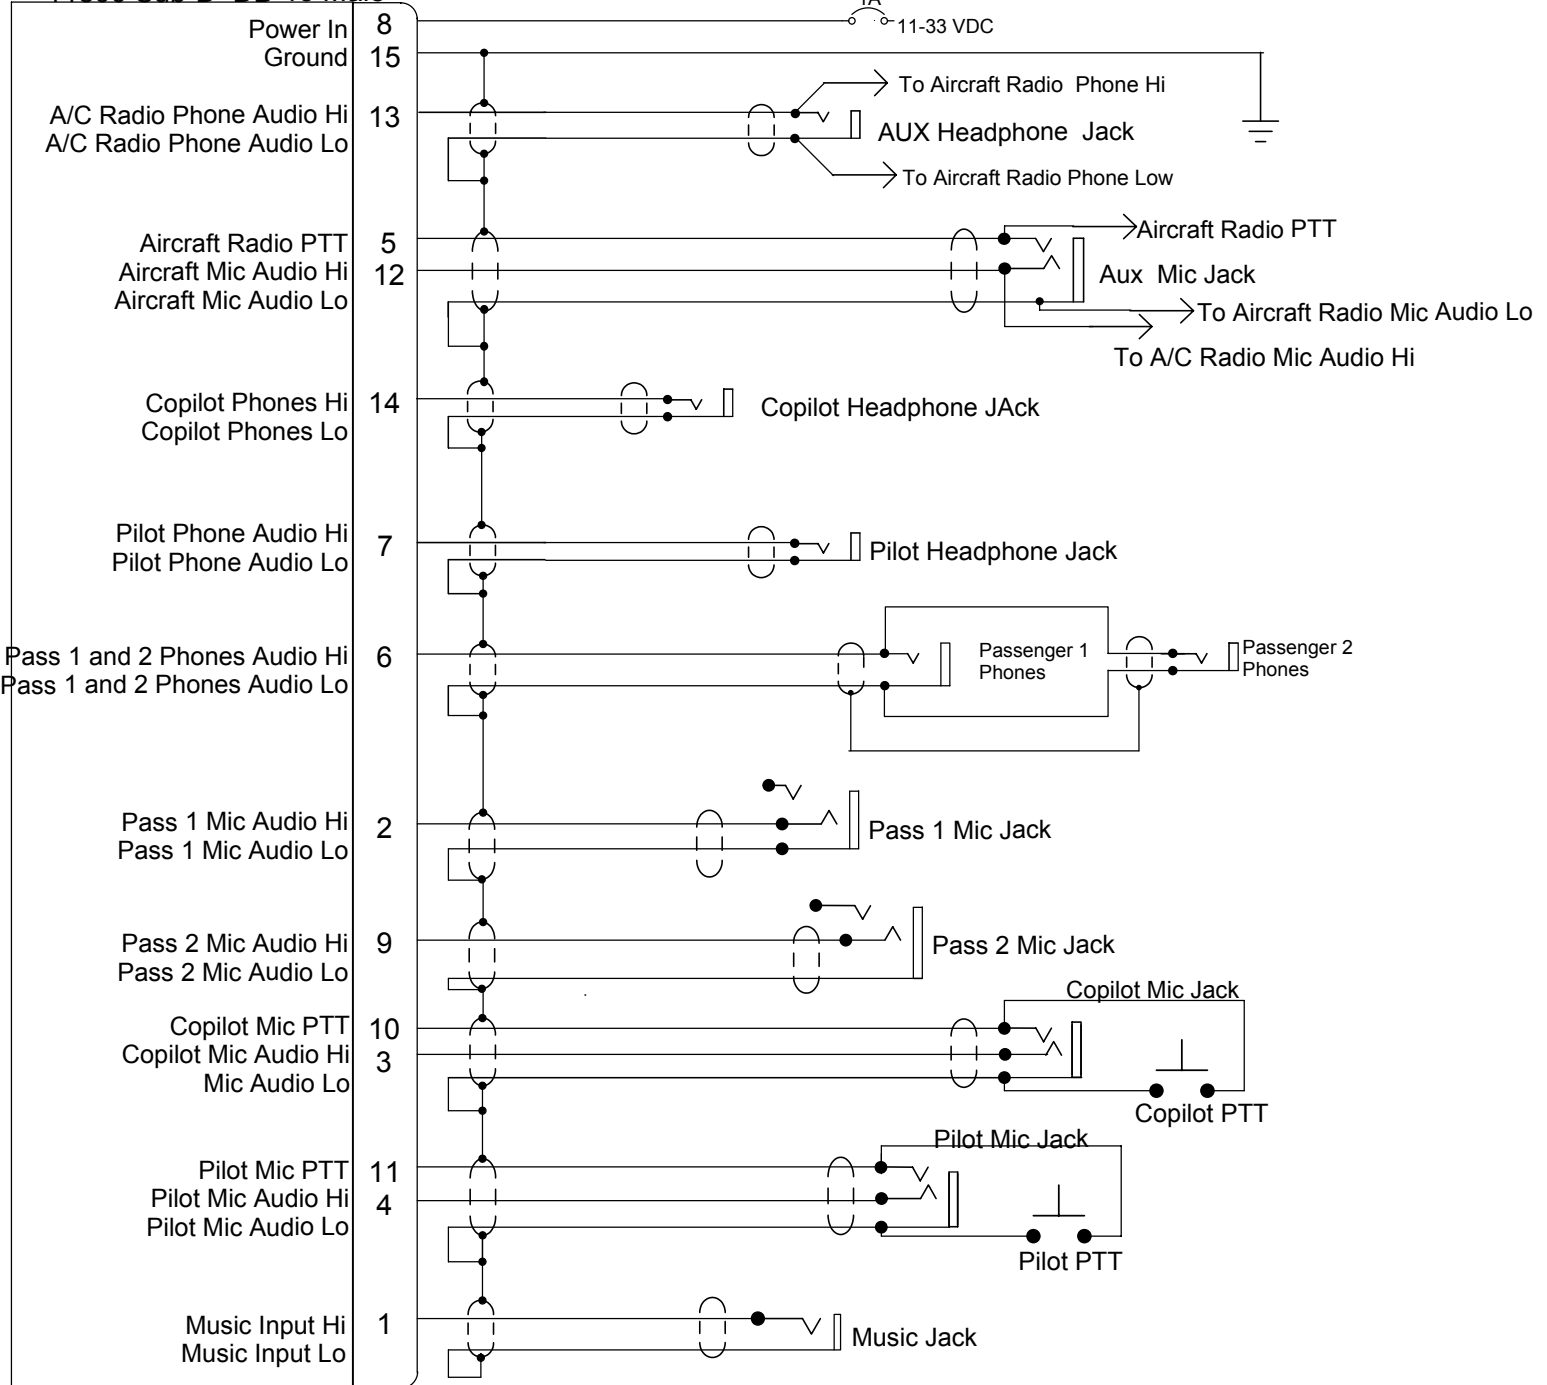

- NOTES:
1. All wire must conform to MIL-22759 or 27500. Minimum 24 gage shielded wire.
 2. Use 2-, and 3-conductor with shield as indicated.
 3. Use insulating washers on all jacks.
 4. Connect shields at intercom end only
 5. AUX headphone and microphone jacks are required.

<p>9800 MARTEL ROAD, LENOIR CITY TN 37772</p>		
TITLE: PM501 (11800) WIRING DIAGRAM		
SIZE	DOCUMENT NUMBER:	REV
	120-180-0000	B
DATE: 09/25/98	SHEET 1 OF 1	
Rev B 09/07/04		